

# Series 760 FireLock® Water Motor Alarm

## PRODUCT DESCRIPTION

The Series 760 FireLock Water Motor Alarm is a mechanical, water-powered device signaling the flow of water in an automatic sprinkler system. The unit is usually installed on a wall with the motor inside the building and the gong outside for maximum audibility. A 100 mesh strainer with 3/4" NPT threaded end connection is provided for compliance with NFPA 13 requirements.

Unless otherwise ordered, the wall setup will be furnished. This will fit wall thicknesses from 2 - 13" (51 - 330 mm). If thicker, specify at the time of order. A riser mounting kit is available that will fit pipe sizes from 2 1/2 - 8" (65 - 200 mm) inclusive, in vertical or horizontal position.


The water motor gong and mechanism are made of aluminum, stainless steel and other non-corrosive materials to prevent rust and staining. Red enamel is standard finish for the gong shell.

**NOTE:** The VdS/CE Listed water motor alarm is provided with ISO 7-1 threads (BSP) and maintains the UL/FM Listings.



See Victaulic publication 10.01 for details.

## DIMENSIONS

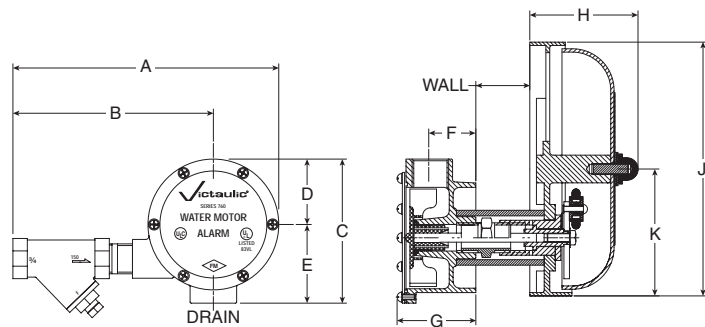

Nominal Size Inches/mm	Dimensions Inches/mm										Aprx. Weight Each Lbs./kg
	A	B	C	D	E	F	G	H	J	K	
3/4	9.19 233	6.87 175	5.23 133	2.32 59	2.90 74	1.73 44	2.79 71	4.17 106	9.02 229	4.51 115	6.7 3.0

---

## OPERATION

For proper operation of this device, the total length of alarm line piping should not exceed 75 feet (23 m). The water motor should not be located more than 20 feet (6 m) above the sprinkler control valve. Alarm line piping from the retard chamber exit to the water motor must be galvanized and at least  $\frac{3}{4}$ " (20 mm) in size. If pressure is low or if longer runs of piping are necessary, larger size piping shall be used.

Not more than three sprinkler systems shall be connected to one water motor alarm and the systems controlled by the valves should be in the same fire area. Check valves shall be installed in the lines from each valve to ensure the proper operation of the water motor gong.

The  $\frac{3}{4}$ " (20 mm) strainer provided should be installed in the alarm prior to the water motor alarm.

Piping shall be pitched so that after operation the water will drain back to the valve and drain through a corrosion resistant orifice not larger than  $\frac{1}{8}$ " (3 mm). Drains shall be conducted to a place where there is no possibility of damage to either persons or property when alarm is operating. Drain pipes shall be so arranged as not to expose any part of the sprinkler system to frost. Wherever possible, drains should be located in a heated space.

---

## INSTALLATION

For Installation Instructions, refer to the I-760 Water Motor Alarm.